


# SEALING OF WATER SUPPLY WELLS IN UNCONSOLIDATED FORMATIONS WITHOUT SIGNIFICANT CLAY BEDS (OAR 690-210-0130)

Overlying Material - Sand and Gravel without Clay

Water-bearing Formation - Sand and Gravel or Similar

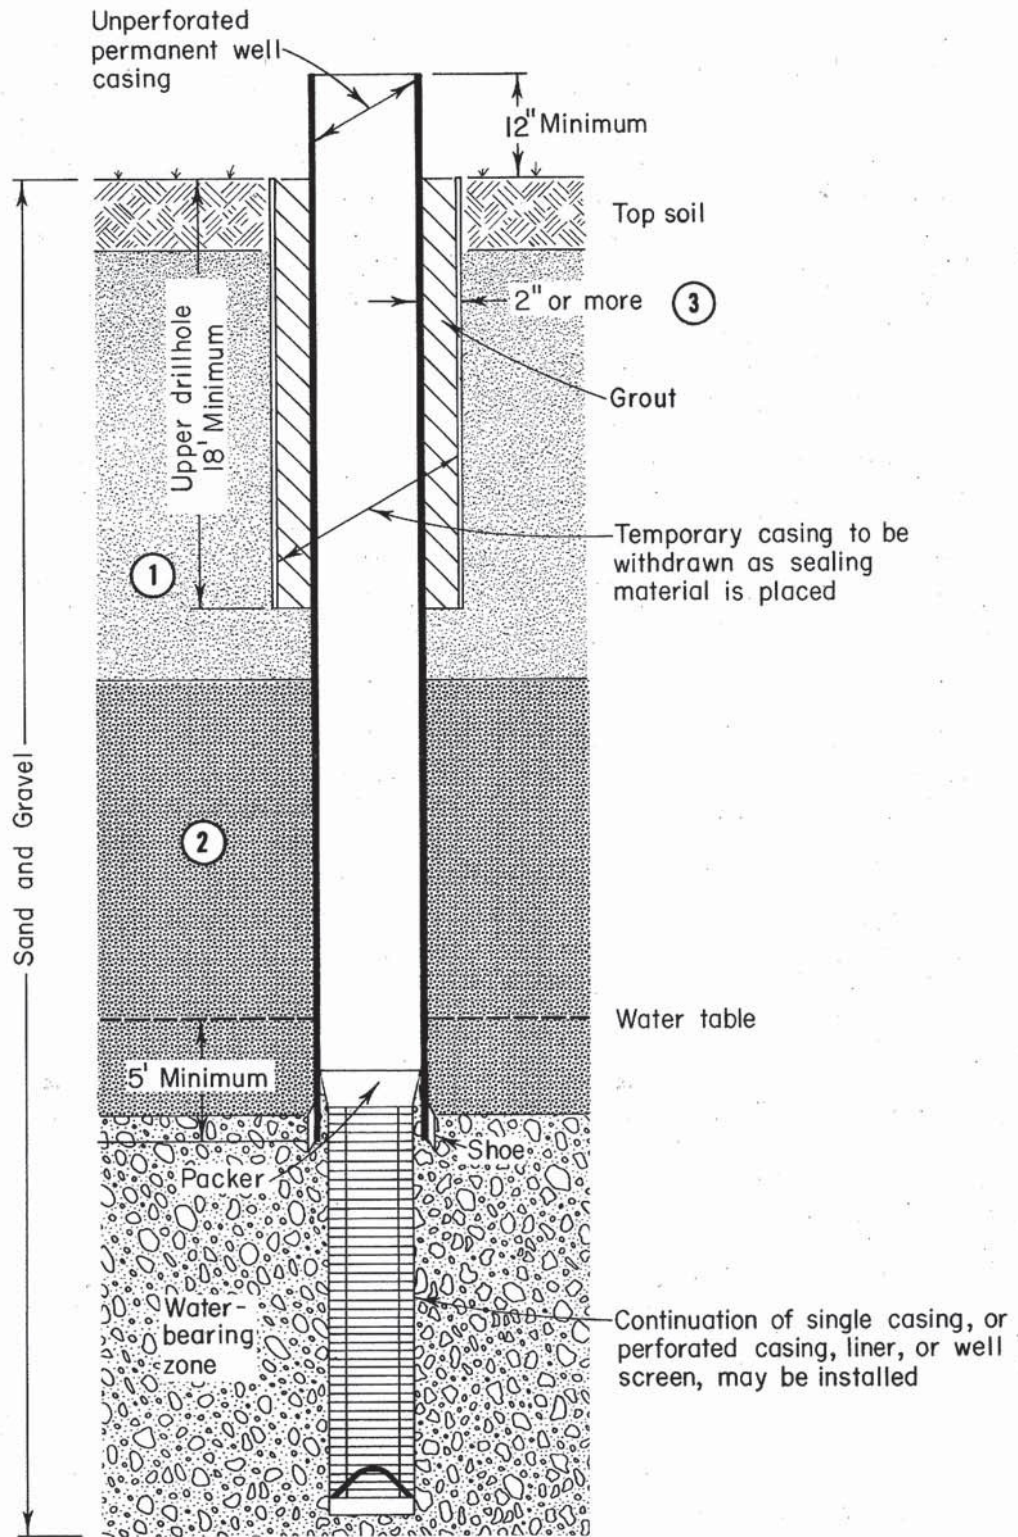

- ① Upper oversize drillhole and annular seal must extend to a depth of at least 18 feet.
- ② Unperforated watertight well casing must extend at least 5 feet below the water table and to a minimum depth of 18 feet.
- ③ Annular sealing space requirements are based on nominal casing sizes