


# SEALING OF AN ARTESIAN WELL

Figure 210-7

(OAR 690-210-0155 and OAR 690-215-0070)

NOTE:  
Petcock and gage may be placed at any of these locations

Control valve and pressure gage must be installed on flowing wells

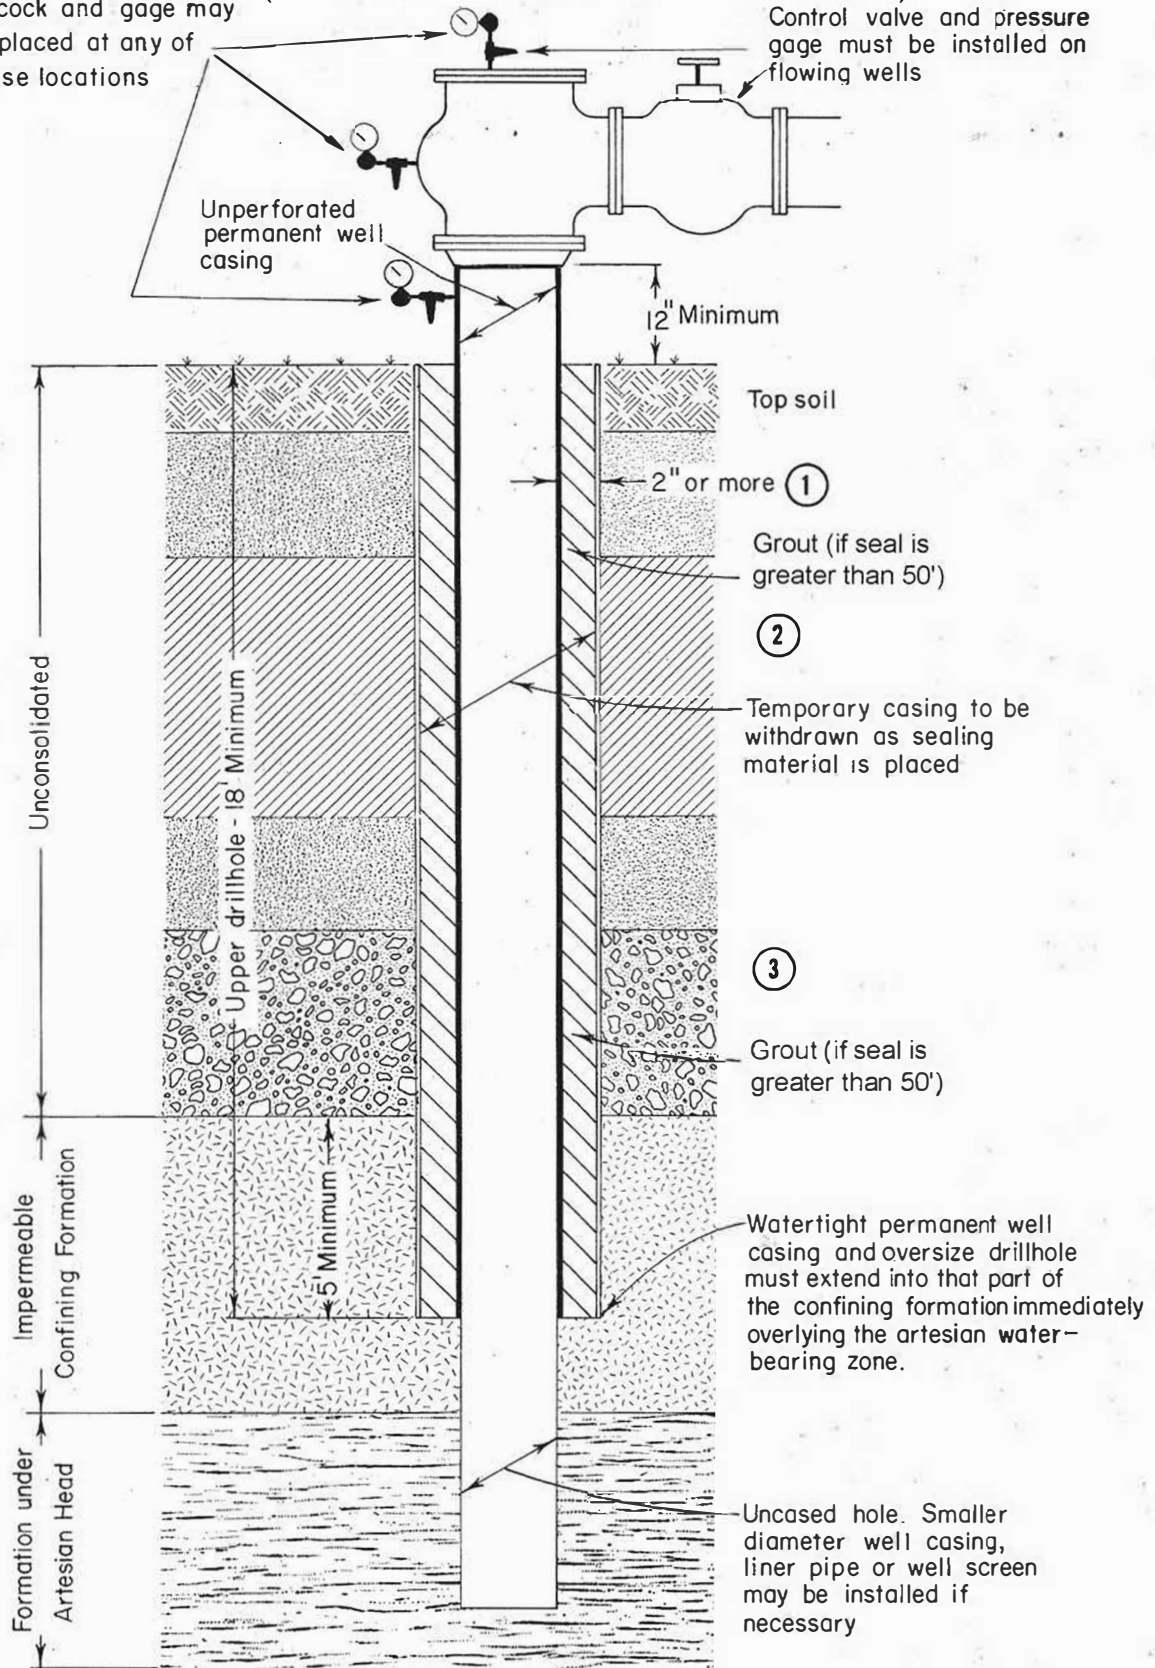

- ① 1" or more if cement grout is placed by grouting method A, B, or D. Annular sealing space requirements are based on nominal casing sizes.
- ② Well must not be constructed in a manner that will allow water from an artesian zone to commingle with other confined or unconfined water-bearing zones.
- ③ Must be completed with the seals, packers, or casing necessary to eliminate subsurface or surface leakage.